



TEST REPORT

Page 1 of 6

REPORT No.: CTB25101504901C01V1

Applicant: SHENZHEN YY TECHNOLOGY CO.,LTD
F3 BUILDING B, YUANLING, HONGXING INDUSTRIAL PARK, SHIYAN TOWN, BAOAN
Address: DISTRICT, SHENZHEN 518108 CHINA

Manufacturer: SHENZHEN YY TECHNOLOGY CO.,LTD
F3 BUILDING B, YUANLING, HONGXING INDUSTRIAL PARK, SHIYAN TOWN, BAOAN
Address: DISTRICT, SHENZHEN 518108 CHINA

The following samples were submitted and identified on behalf of the clients as:

Sample name: Aluminum Package
Brand: /
Model(s): /
Sample received date: Oct. 15, 2025
Testing period: Oct. 15, 2025 to Oct. 22, 2025

Test Method: Please refer to next page(s).

Test Result: Please refer to next page(s).

Remark: The current report with No.: CTB25101504901C01V1 is changed the photo based on previous report: CTB25101504901C01 issued by CTB testing lab. The test data and conclusions presented herein are derived from the original report CTB25101504901C01. The previous report becomes invalid when the revised report issued.

Result Summary:

Test Requested	Conclusion
US FDA.CPG 7117.05	PASS
US FDA 21 CFR 175.300	PASS

Tested By: 	Check By: 	Approve By:  
--	---	--

Date: Oct. 24, 2025

TEST REPORT

Page 2 of 6

REPORT No.: CTB25101504901C01V1

Sample Description:

No.	Description	Material
1	Silver metal	Aluminum
2	Epoxy resin coating	Coating

Test Result:

US FDA.CPG 7117.05

As specified by client, to determine the Extractable Lead content in accordance with American Food and Drug Administration(FDA) Compliance Policy Guides 7117.05.use:

Item	Unit	Limit	Result
			1
Extractable Lead(Pb), 4% acetic acid, 22±2°C, 24h	ug/ml	Adult:7 Child:0.5	N.D
Conclusion	---	---	PASS

US FDA 21 CFR 175.300, Resinous and polymeric coatings

Test condition:

1. Water: 120deg. F, 24 hours
2. Heptane: 70deg. F, 30 min
3. 8% alcohol: 120 deg. F, 24hours

Test item	Limit (mg/in ²)	MDL (mg/in ²)	Results (mg/in ²)
			1
Chloroform-soluble extractive - Water	18	0.1	N.D
Chloroform-soluble extractive - Heptane	18	0.1	N.D
Chloroform-soluble extractive - 8% alcohol	18	0.1	N.D
Conclusion	--	--	PASS

TEST REPORT

Page 3 of 6


REPORT No.: CTB25101504901C01V1

Test item	Limit (mg/in ²)	MDL (mg/in ²)	Results (mg/in ²)
			2
Chloroform-soluble extractive - Water	18	0.1	N.D
Chloroform-soluble extractive - Heptane	18	0.1	N.D
Chloroform-soluble extractive - 8% alcohol	18	0.1	N.D
Conclusion	--	--	PASS

Note:

1. mg/in² = milligram per square inch
2. N.D = Not detected (less than MDL)
3. MDL = Method detection limit

Photo documentation

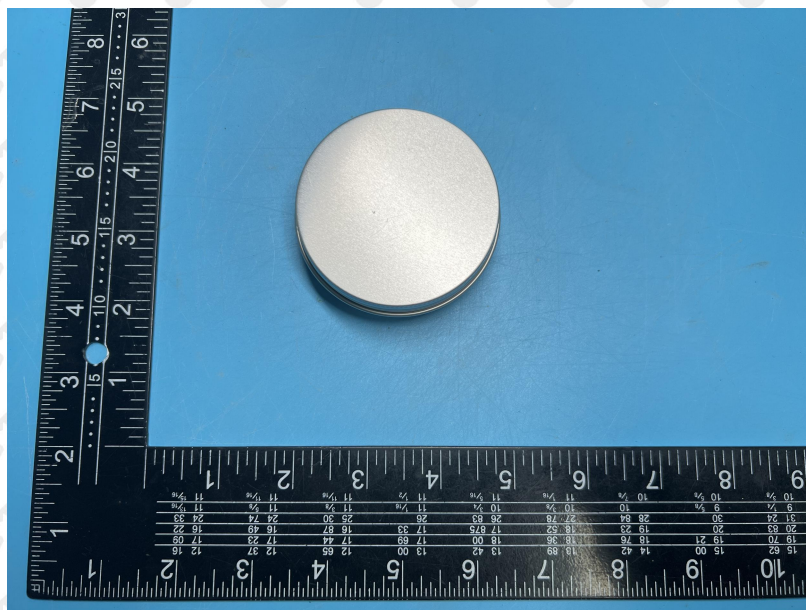

TEST REPORT

Page 4 of 6


REPORT No.: CTB25101504901C01V1



TEST REPORT

Page 5 of 6


REPORT No.: CTB25101504901C01V1

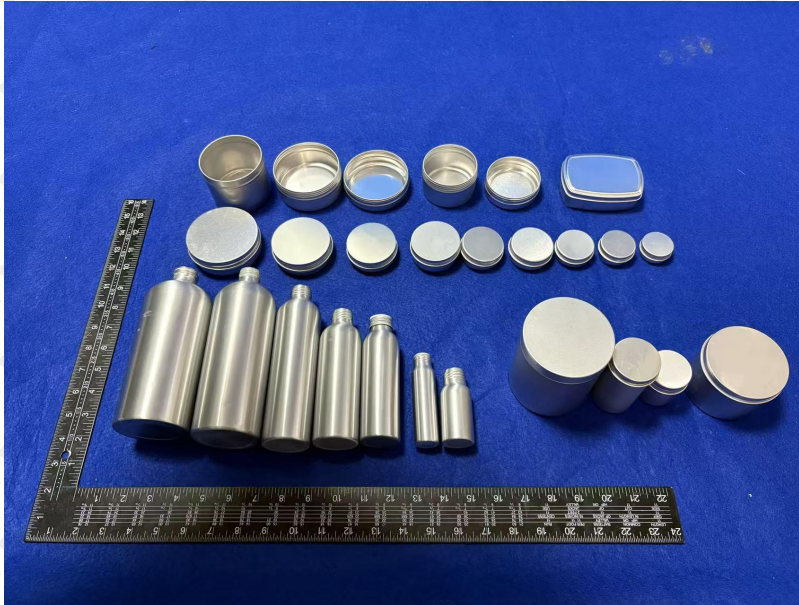

TEST REPORT

Page 6 of 6

REPORT No.: CTB25101504901C01V1

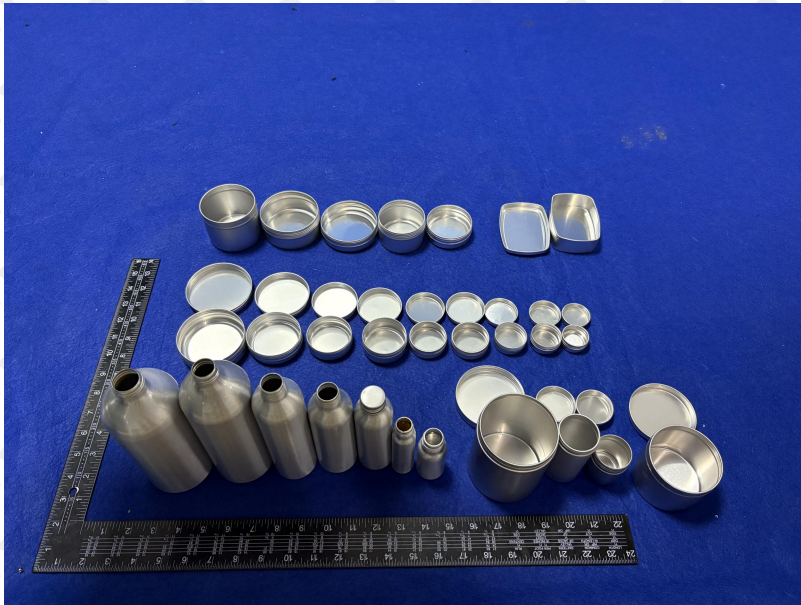

*** End of Report ***

Note: If there is any objection to the inspection results in this report, please submit a written report to the company within 15 days from the date of receiving the report. The test report is effective only with both signature and specialized stamp. This result(s) shown in this report refer only to the sample(s) tested. Without written approval of Shenzhen CTB Testing Technology Co., Ltd. this report can't be reproduced except in full. The tested sample(s) and the sample information are provided by the client. "★" indicates the testing items were fulfilled by subcontracted lab. "※" indicates the items are not in CNAS accreditation scope.